


DISCLAIMER: The use of this standard is governed by the City of Wichita Falls Engineering Department. No warranty of any kind is made by the City of Wichita Falls for any purpose whatsoever. The City of Wichita Falls assumes no responsibility for the conversion of this standard to other formats for incorrect results or damages resulting from its use.

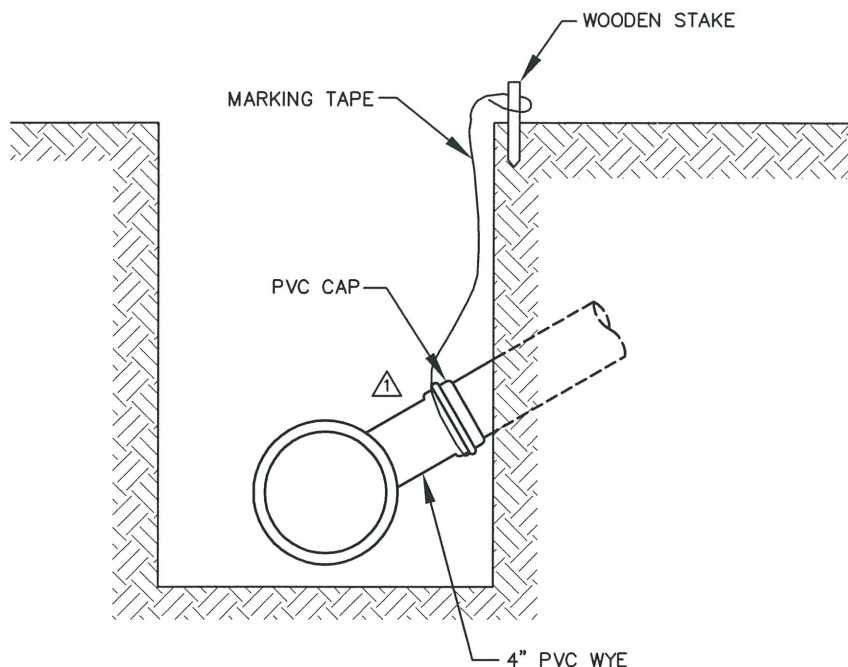

SANITARY SEWER SERVICE CONNECTION

NOT TO SCALE

GENERAL NOTES:

1. USE LINEGUARD DETECTABLE UNDERGROUND MARKING TAPE NO. 43186 OR EQUAL ON SERVICE CONNECTIONS.
2. FUTURE PRIVATE MAINTENANCE OF SERVICE CONNECTIONS BEGINS AT SERVICE WYE.
- △ 3. 4" SEWER WYE SHALL BE PLACED AT EITHER THE 2 OCLOCK OR 10 OCLOCK POSITION AS SHOWN.

	DEC 03		5050-00		CITY OF WICHITA FALLS, TX	
	DATE DRAWN		STANDARD DRAWING NO.		SANITARY SEWER SERVICE CONNECTION	
	△	06/05	ADDED NOTE THREE	DJB	APPROVED	
	NO.	DATE	DESCRIPTION	BY	JUNE 2005	
SERVICE_CONNECT_SS	R	E	V	I	S	I
ACAD DRAWING NAME					CITY ENGINEER	

CITY ENGINEER

JUNE 2005
DATE